
































LICENSING LEGEND:	
	AREA WHERE LICENSABLE ACTIVITIES WILL TAKE PLACE. THE POSITION OF THE FIRE EQUIPMENT IS CORRECT AT THE DATE OF SUBMISSION BUT MAY CHANGE FROM TIME TO TIME WITH APPROVAL OF THE FIRE OFFICER. ANY SEATING SHOWN ON THE PLANS WHICH IS UNFIXED IS INDICATIVE AND MAY CHANGE FROM TIME TO TIME
	AREA OF EXTERNAL SEATING WHERE LICENSABLE ACTIVITIES WILL TAKE PLACE
	TRAVEL DISTANCE TO EMERGENCY PLACE OF REFUGE OR EXIT


FIRE & SAFETY									
	FIRE ALARM CALL POINT / BREAK GLASS CALL PULL		AREA COVERED BY SMOKE DETECTOR WITH COMBINED ALARM SOUNDER		ILLUMINATED SIGN - FIRE EXIT OR GRAPHIC EQUIVALENT 75MM LETTERS (B55499)		PANIC BAR TO DOOR		DISABLED REFUGE CALL POINT
	WATER FIRE EXTINGUISHER - NO. INDICATES LITRE CAPACITY		AREA COVERED BY EMERGENCY LIGHTING (B5 5266)		ILLUMINATED SIGN - DIRECTIONAL FIRE EXIT OR GRAPHIC EQUIVALENT 75MM LETTERS (B55499)		ALARM SOUNDER	 	MAGNETIC DOOR HOLD OPEN LINKED TO FIRE ALARM. (BS EN 1155) & SIGN: AUTOMATIC FIRE DOOR KEEP CLEAR (B55499) BOTH SIDES
	CARBON DIOXIDE EXTINGUISHER - NO. INDICATES KG CAPACITY		SIGN: FIRE DOOR KEEP SHUT (B55499) BOTH SIDES		PIR MOTION DETECTOR CONNECTED TO FIRE ALARM		DISABLED VISIBLE ALARM BEACON		
	FOAM FIRE EXTINGUISHER - NO. INDICATES LITRE CAPACITY		SIGN: FIRE DOOR KEEP LOCKED (B55499)		EMERGENCY EXIT SIGN		CEILING SPRINKLER		
	FIRE BLANKET CONTAINER		SIGN: FIRE ESCAPE KEEP CLEAR (B55499)		DIRECTIONAL EMERGENCY EXIT SIGN		FIRE ALARM PANEL		
	AREA COVERED BY AUTOMATIC HEAT DETECTORS		SIGN: FIRE EXIT OR GRAPHIC EQUIVALENT 75MM LETTERS (B55499)		30/60 MINS FIRE PROTECTED DOOR WITH SMOKE SEALANTS		FIRE ALARM REPEAT PANEL		
	AREA COVERED BY AUTOMATIC SMOKE DETECTORS		DIRECTIONAL ARROW TO BE PROVIDED WITH S22 NOTICE (B55499)		30/60 MINS FIRE PROTECTED GLASS DOOR WITH SMOKE SEALANTS		FIRE ALARM INTERFACE		



01 GROUND FLOOR PLAN
1:100 @ A1

02 GROUND FLOOR PLAN
1:100 @ A1

LICENSING LEGEND:		FIRE & SAFETY									
	AREA WHERE LICENSABLE ACTIVITIES WILL TAKE PLACE. THE POSITION OF THE FIRE EQUIPMENT IS CORRECT AT THE DATE OF SUBMISSION BUT MAY CHANGE FROM TIME TO TIME WITH APPROVAL OF THE FIRE OFFICER. ANY SEATING SHOWN ON THE PLANS WHICH IS UNFIXED IS INDICATIVE AND MAY CHANGE FROM TIME TO TIME		FIRE ALARM CALL POINT / BREAK GLASS CALL PULL		AREA COVERED BY SMOKE DETECTOR WITH COMBINED ALARM SOUNDER		ILLUMINATED SIGN - FIRE EXIT OR GRAPHIC EQUIVALENT 75MM LETTERS (B55499)		PANIC BAR TO DOOR		DISABLED REFUGE CALL POINT
	AREA OF EXTERNAL SEATING WHERE LICENSABLE ACTIVITIES WILL TAKE PLACE		WATER FIRE EXTINGUISHER - NO. INDICATES LITRE CAPACITY		AREA COVERED BY EMERGENCY LIGHTING (BS 5266)		ILLUMINATED SIGN - DIRECTIONAL FIRE EXIT OR GRAPHIC EQUIVALENT 75MM LETTERS (B55499)		ALARM SOUNDER		MAGNETIC DOOR HOLD OPEN LINKED TO FIRE ALARM (BS EN 1155) & SIGN: AUTOMATIC FIRE DOOR KEEP CLEAR (B55499) BOTH SIDES
	TRAVEL DISTANCE TO EMERGENCY PLACE OF REFUGE OR EXIT		CARBON DIOXIDE EXTINGUISHER - NO. INDICATES KG CAPACITY		SIGN: FIRE DOOR KEEP SHUT (B55499) BOTH SIDES		PIR MOTION DETECTOR CONNECTED TO FIRE ALARM		DISABLED VISIBLE ALARM BEACON		SIDE WALL SPRINKLER
			FOAM FIRE EXTINGUISHER - NO. INDICATES LITRE CAPACITY		SIGN: FIRE DOOR KEEP LOCKED (B55499)		EMERGENCY EXIT SIGN		CEILING SPRINKLER		
			FIRE BLANKET CONTAINER		SIGN: FIRE ESCAPE KEEP CLEAR (B55499)		DIRECTIONAL EMERGENCY EXIT SIGN		FIRE ALARM PANEL		
			AREA COVERED BY AUTOMATIC HEAT DETECTORS		SIGN: FIRE EXIT OR GRAPHIC EQUIVALENT 75MM LETTERS (B55499)		30/60 MINS FIRE PROTECTED DOOR WITH SMOKE SEALANTS		FIRE ALARM REPEAT PANEL		
			AREA COVERED BY AUTOMATIC SMOKE DETECTORS		DIRECTIONAL ARROW TO BE PROVIDED WITH S22 NOTICE (B55499)		30/60 MINS FIRE PROTECTED GLASS DOOR WITH SMOKE SEALANTS		FIRE ALARM INTERFACE		

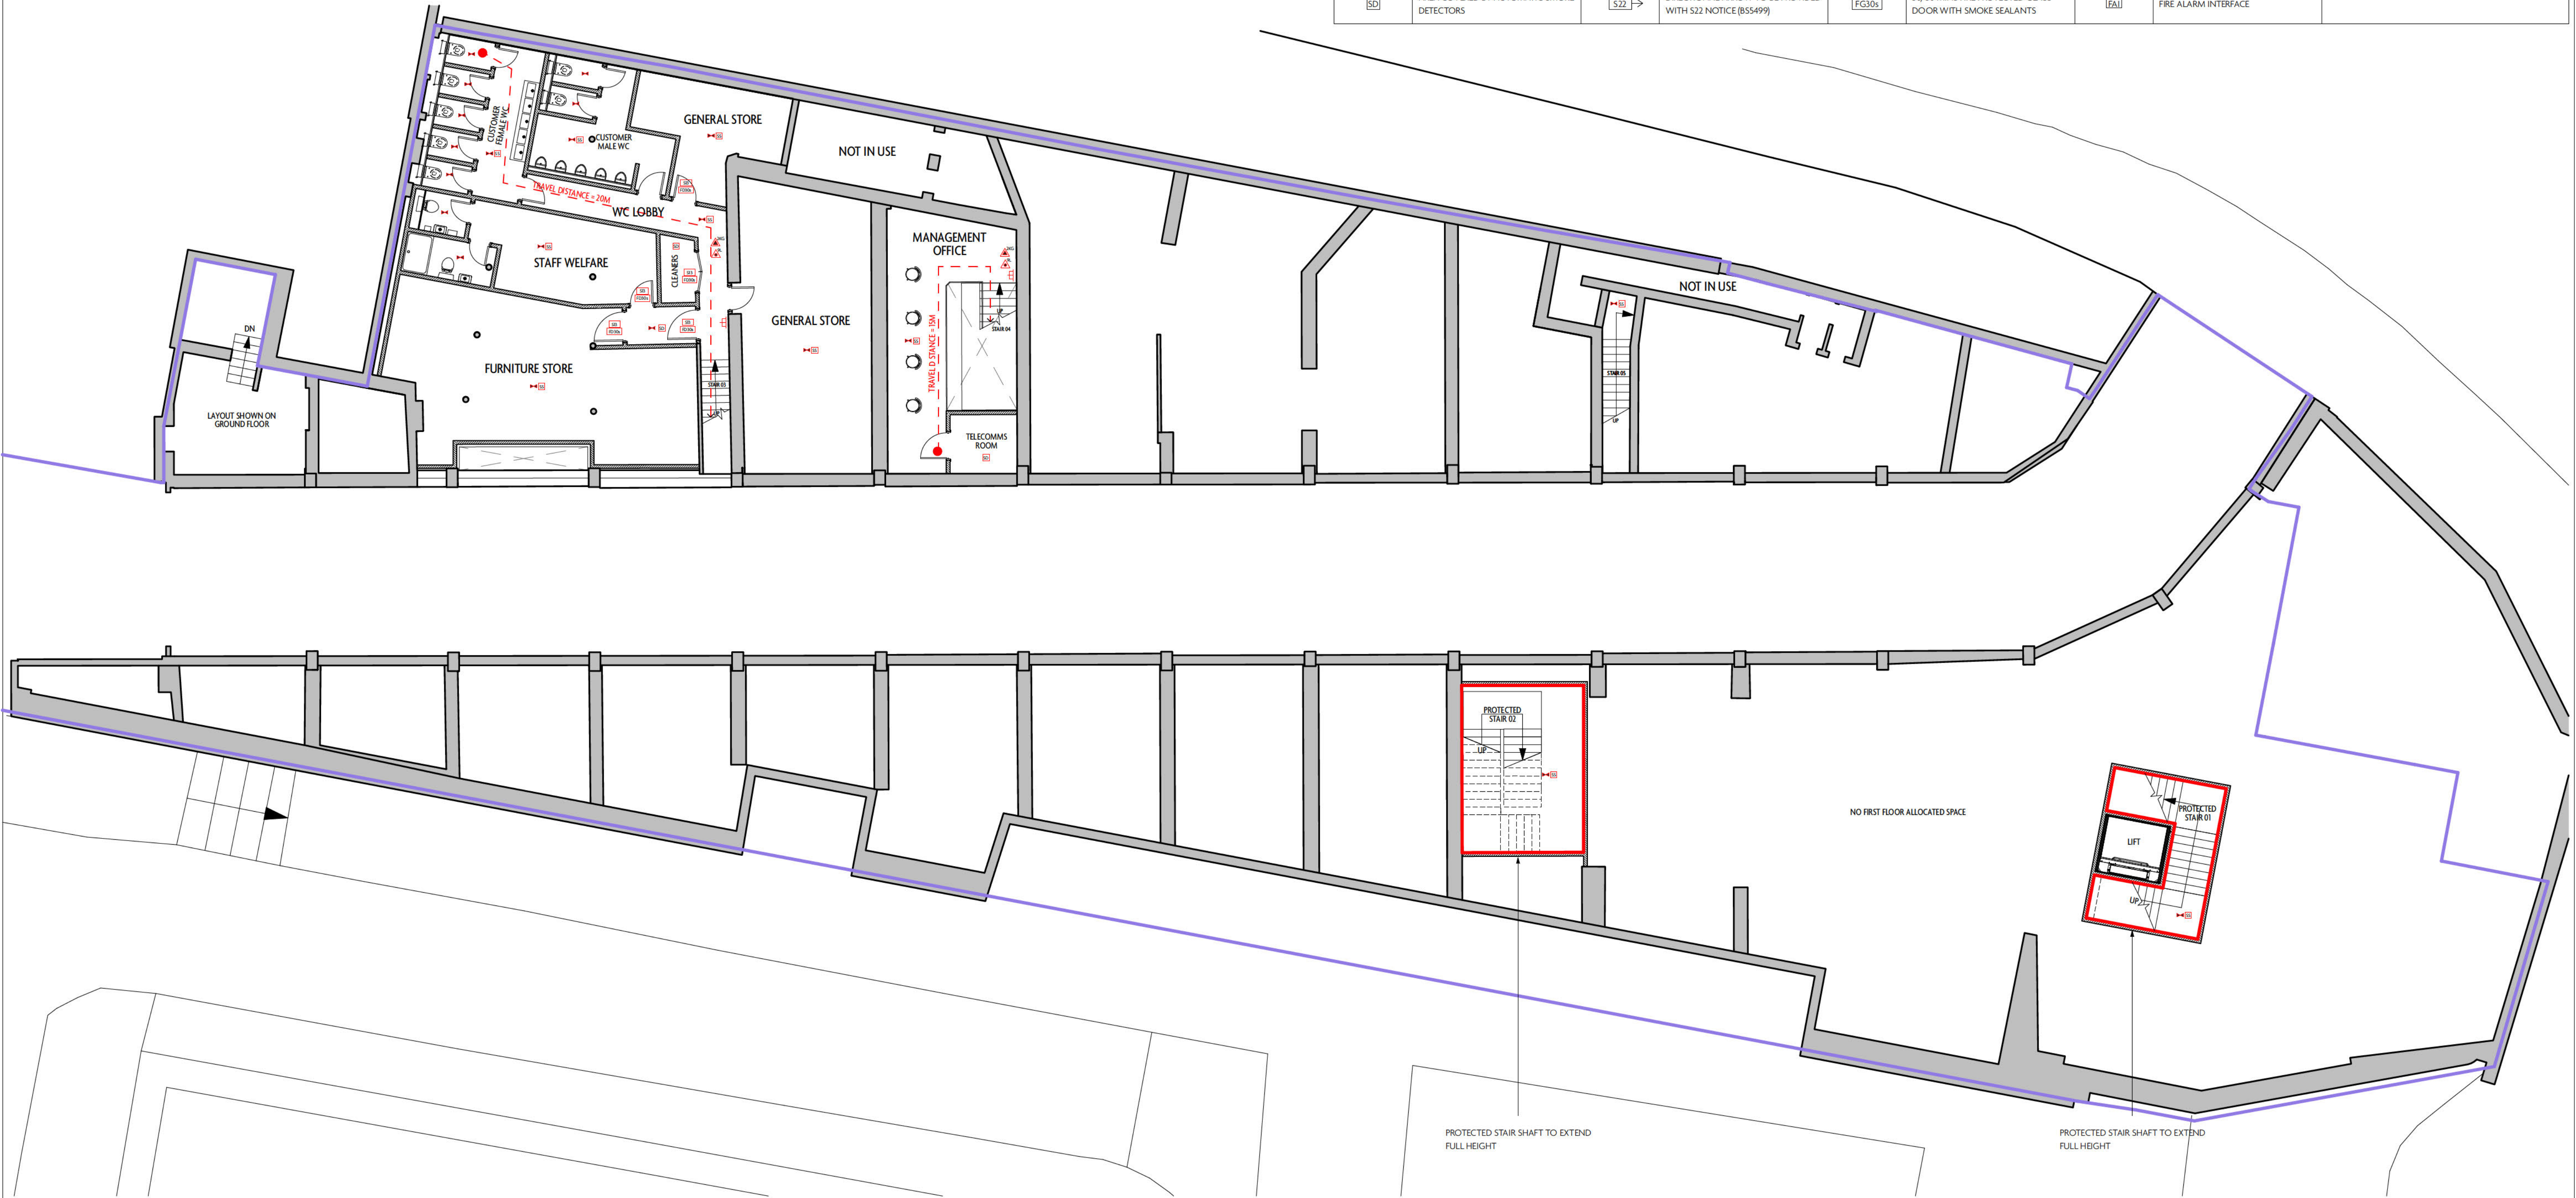

01 FIRST FLOOR PLAN
1:100 @ A1

LICENSING LEGEND:	
	AREA WHERE LICENSABLE ACTIVITIES WILL TAKE PLACE. THE POSITION OF THE FIRE EQUIPMENT IS CORRECT AT THE DATE OF SUBMISSION BUT MAY CHANGE FROM TIME TO TIME WITH APPROVAL OF THE FIRE OFFICER. ANY SEATING SHOWN ON THE PLANS WHICH IS UNFIXED IS INDICATIVE AND MAY CHANGE FROM TIME TO TIME
	AREA OF EXTERNAL SEATING WHERE LICENSABLE ACTIVITIES WILL TAKE PLACE
	TRAVEL DISTANCE TO EMERGENCY PLACE OF REFUGE OR EXIT

FIRE & SAFTEY									
	FIRE ALARM CALL POINT / BREAK GLASS CALL PULL		AREA COVERED BY SMOKE DETECTOR WITH COMBINED ALARM SOUNDER		ILLUMINATED SIGN - FIRE EXIT OR GRAPHIC EQUIVALENT 75MM LETTERS (B55499)		PANIC BAR TO DOOR		DISABLED REFUGE CALL POINT
	WATER FIRE EXTINGUISHER - NO. INDICATES LITRE CAPACITY		AREA COVERED BY EMERGENCY LIGHTING (BS 5266)		ILLUMINATED SIGN - DIRECTIONAL FIRE EXIT OR GRAPHIC EQUIVALENT 75MM LETTERS (B55499)		ALARM SOUNDER		MAGNETIC DOOR HOLD OPEN LINKED TO FIRE ALARM (BS EN 1155) & SIGN: AUTOMATIC FIRE DOOR KEEP CLEAR (B55499) BOTH SIDES
	CARBON DIOXIDE EXTINGUISHER - NO. INDICATES KG CAPACITY		SIGN: FIRE DOOR KEEP SHUT (B55499) BOTH SIDES		PIR MOTION DETECTOR CONNECTED TO FIRE ALARM		DISABLED VISIBLE ALARM BEACON		SIDE WALL SPRINKLER
	FOAM FIRE EXTINGUISHER - NO. INDICATES LITRE CAPACITY		SIGN: FIRE DOOR KEEP LOCKED (B55499)		EMERGENCY EXIT SIGN		CEILING SPRINKLER		
	FIRE BLANKET CONTAINER		SIGN: FIRE ESCAPE KEEP CLEAR (B55499)		DIRECTIONAL EMERGENCY EXIT SIGN		FIRE ALARM PANEL		
	AREA COVERED BY AUTOMATIC HEAT DETECTORS		SIGN: FIRE EXIT OR GRAPHIC EQUIVALENT. 75MM LETTERS (B55499)		30/60 MINS FIRE PROTECTED DOOR WITH SMOKE SEALANTS		FIRE ALARM REPEAT PANEL		
	AREA COVERED BY AUTOMATIC SMOKE DETECTORS		DIRECTIONAL ARROW TO BE PROVIDED WITH S22 NOTICE (B55499)		30/60 MINS FIRE PROTECTED GLASS DOOR WITH SMOKE SEALANTS		FIRE ALARM INTERFACE		

