


Appendix 1. Energy performance

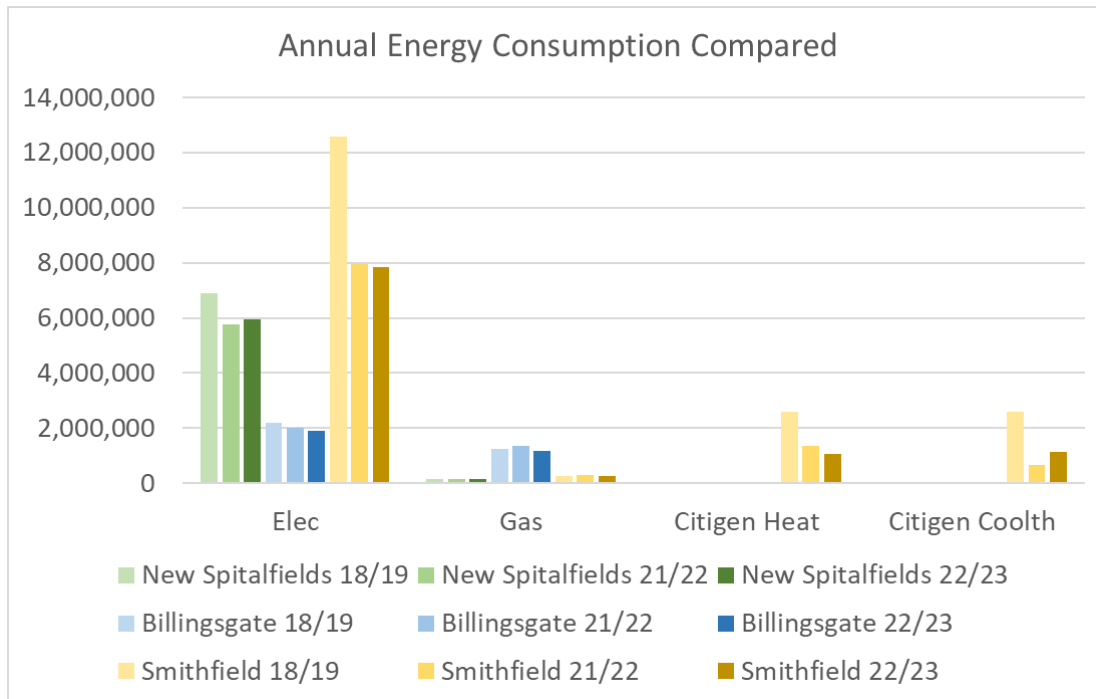


2022/23 compared to 2018/19

Site	Elec	Gas	Citigen Heat	Citigen Coolth	Total
New Spitalfields	-14%	6%	N/A	N/A	-13%
Billingsgate	-14%	-5%	N/A	N/A	-11%
Smithfield	-38%	7%	-59%	-57%	-43%
Total	-28%	-2%	-59%	-57%	-32%

2022/23 compared to 2021/22

Site	Elec	Gas	Citigen Heat	Citigen Coolth	Total
New Spitalfields	3%	1%	N/A	N/A	3%
Billingsgate	-7%	-12%	N/A	N/A	-9%
Smithfield	-1%	-15%	-23%	67%	0%
Total	0%	-11%	-23%	67%	-1%

Appendix 2. Carbon performance

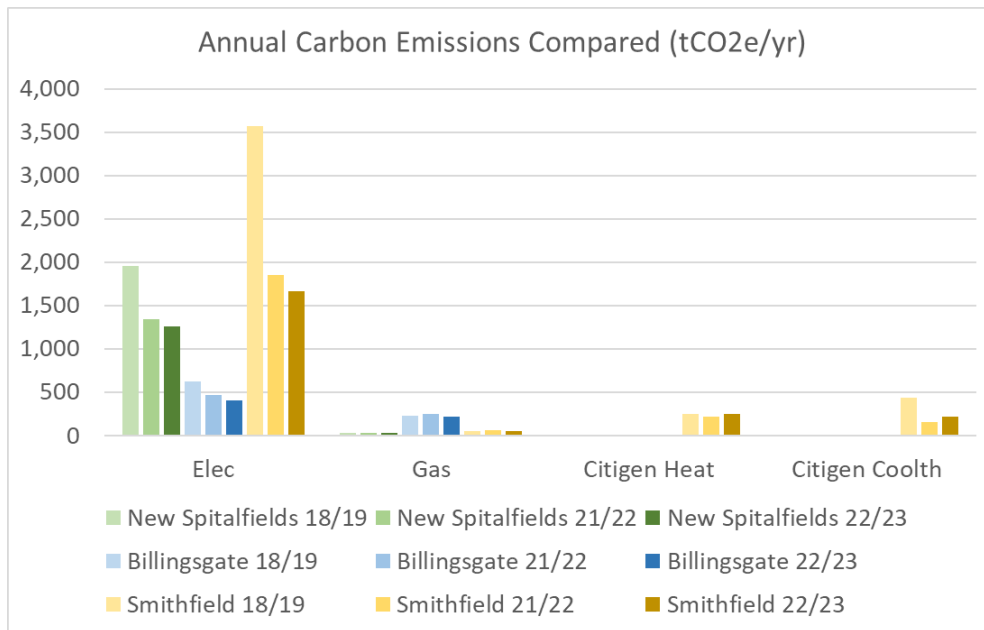

2022/23 compared to 2018/19

	Elec	Gas	Citigen Heat	Citigen Coolth	Total
New Spitalfields	-35%	5%	N/A	N/A	-35%
Billingsgate	-36%	-5%	N/A	N/A	-28%
Smithfield	-53%	7%	-2%	-50%	-49%
Total	-46%	-2%	-2%	-50%	-43%

2022/23 compared to 2021/22

	Elec	Gas	Citigen Heat	Citigen Coolth	Total
New Spitalfields	-6%	0%	N/A	N/A	-6%
Billingsgate	-15%	-12%	N/A	N/A	-14%
Smithfield	-10%	-15%	15%	38%	-5%
Total	-9%	-11%	15%	38%	-7%

Appendix 3. Energy costs

